


➤ SENSOR, BUTTON, BELL, MODULE, LOAD CAPACITY

10.04.2018

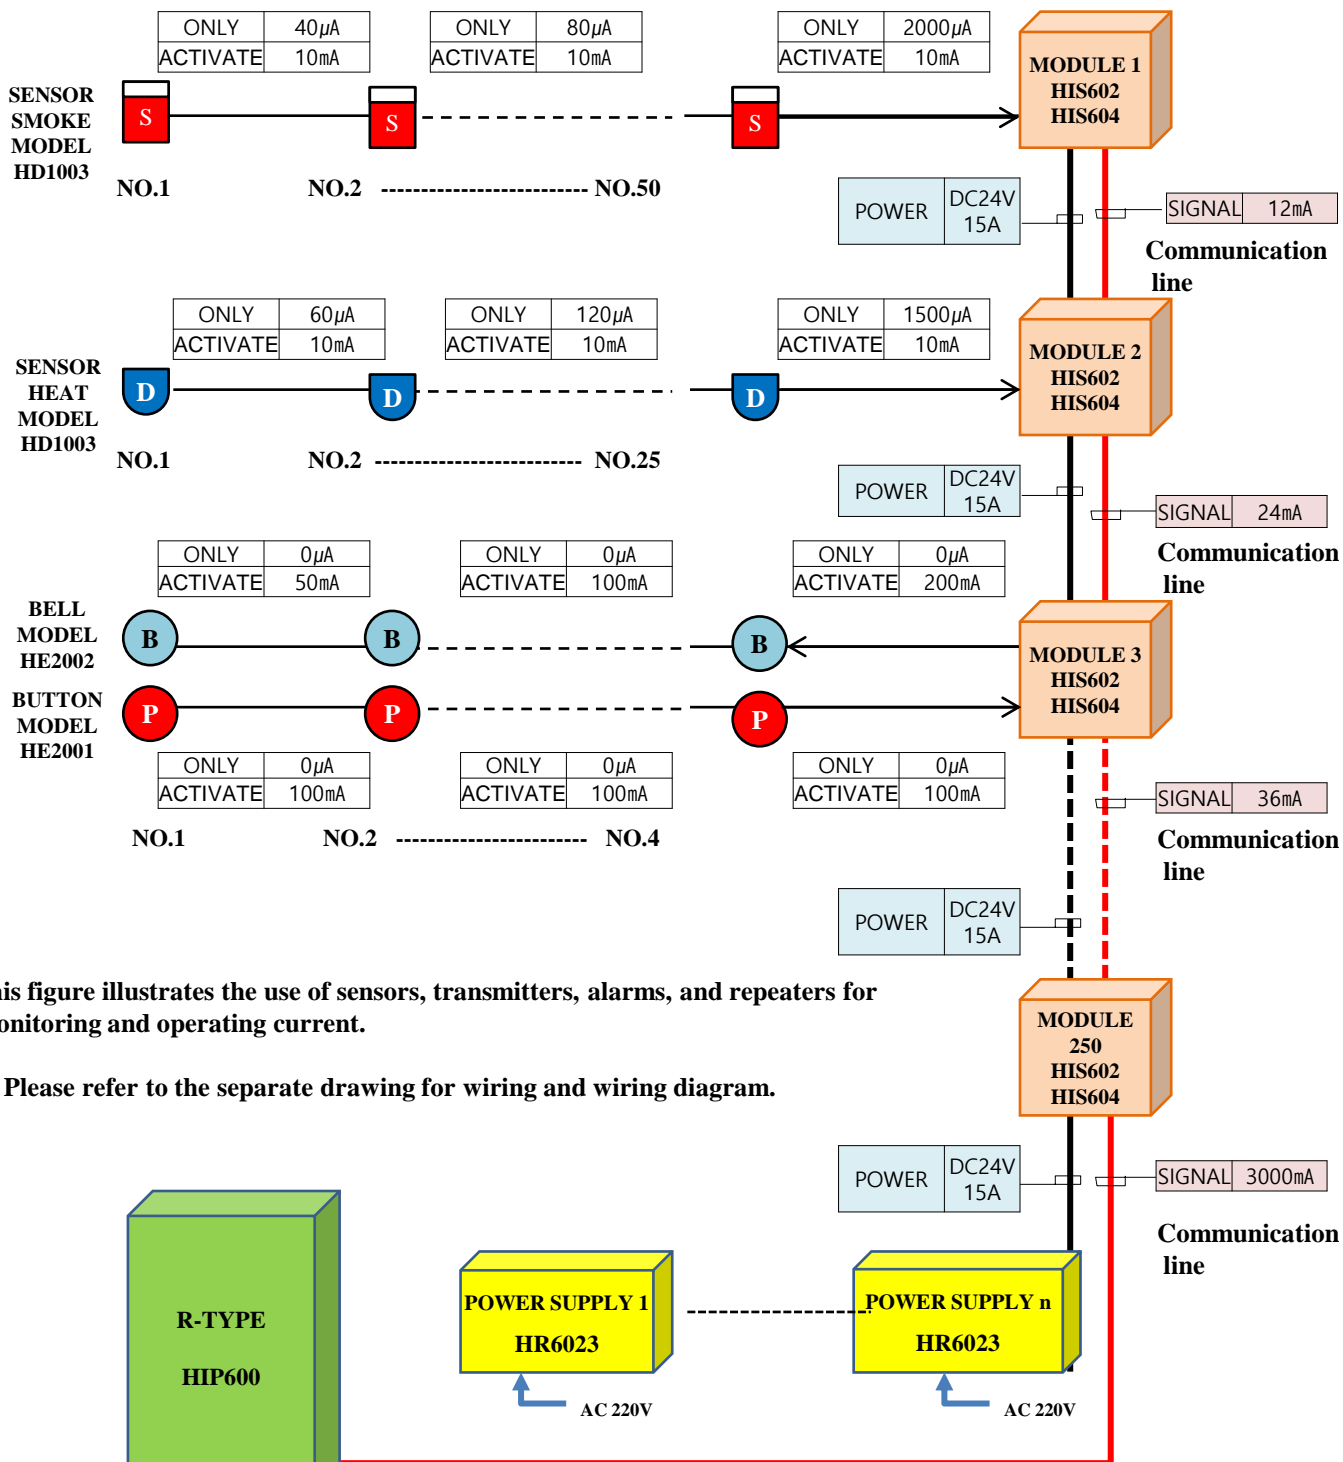

This figure illustrates the use of sensors, transmitters, alarms, and repeaters for Monitoring and operating current.

※ Please refer to the separate drawing for wiring and wiring diagram.

MODULE (HIS602 , 604) MAX CURRENT 1A
CONTROL PANEL (HIP600) MAX CURRENT 3A
 * 1000μA = 1mA.
 * 1000mA = 1A

HIMAX VINA

TEL : +84.28.3620.4911-2 Fax : +84.28.3620.4913

E-mail: himax119@gmail.com

Website: www.himax119.vn